



Underground Electrical Service Revision Worksheet

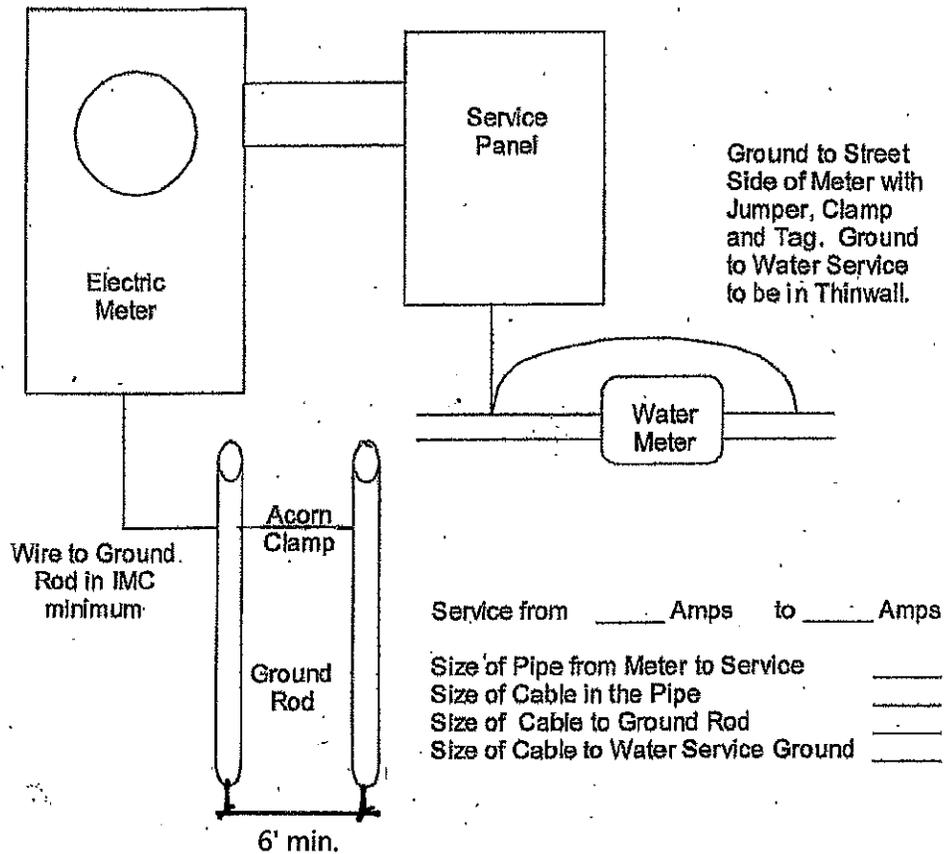

Requirements/Notes:

1. A copy of electrician's registration **MUST** be attached to all permit applications.
2. A copy of electrician's insurance **MUST** be attached to all permit applications.
3. When converting from overhead to underground service, service lateral conductors must be protected.
4. Electric meter must be a minimum of 3 feet from gas meter.
5. Panel directory must be completely marked.

Overhead Electrical Service Revision Worksheet

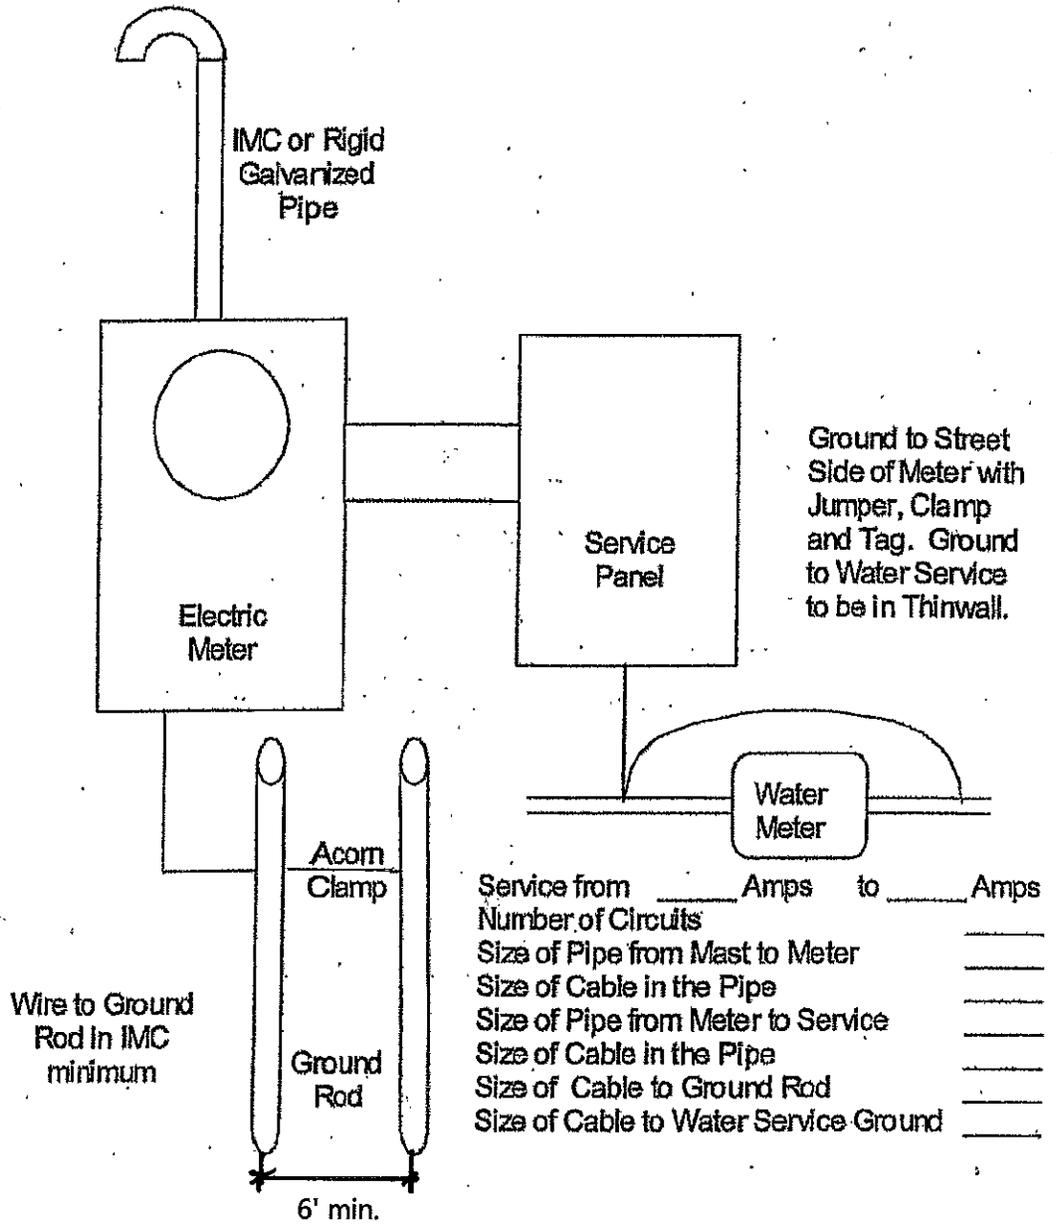

Requirements/Notes:

1. A copy of electrician's registration **MUST** be attached to all permit applications.
2. A copy of electrician's insurance **MUST** be attached to all permit applications.
3. Electric meter must be a minimum of 3 feet from gas meter.
4. Panel directory must be completely marked.